


**ALBUQUERQUE FIRE DEPARTMENT  
FIRE MARSHAL'S OFFICE APPROVED  
EXTENSION CORD/TEMPORARY WIRING**

# Option 1

Power cord must be:


- minimum 14 gauge
- grounded with molded single female end



a

b

c

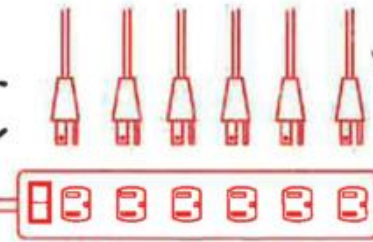

Appliances only!

Only appliances are allowed to be plugged in at this point (C). No extension cords past this point.

All power strips must:


- have surge protection
- be grounded
- be 14 Gauge minimum

— Only approved and listed UL, FM, or NRTL minimum 14 gauge three wire extension cords will be allowed. Multi-plug adapters shall not be used but "power strip" with their own circuit breaker may be used. The ampacity of the extension cord shall not be less than the rated capacity of the portable appliance supplied by the cord.\*

# Option 2


Power cord must be:

- minimum 14 gauge
- grounded with molded multi-tap female end



b

c

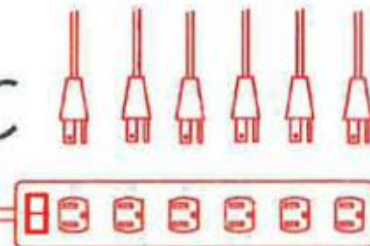

Appliances only!

— Connection (a)

Option 1: Extension cord with one outlet

Option 2: Extension Cord w/ three outlets, of which only two can be used.

Connection (B)

Option 1-2: Can plug in power strip, or single appliance. Two appliances being the maximum on option 2.

Connection (c)

Options 1-2: Only appliances can be plugged into power strips at this connection. **NO EXTENSION CORDS**

c

